

ELEV 100

NZJB

NON-CERTIFICATED


WAIRAU HOSPITAL

HELIPORT

UNATTENDED: 122.8


WOODBOURNE TOWER: 122.8 118.1

WOODBOURNE ATIS: 126.05

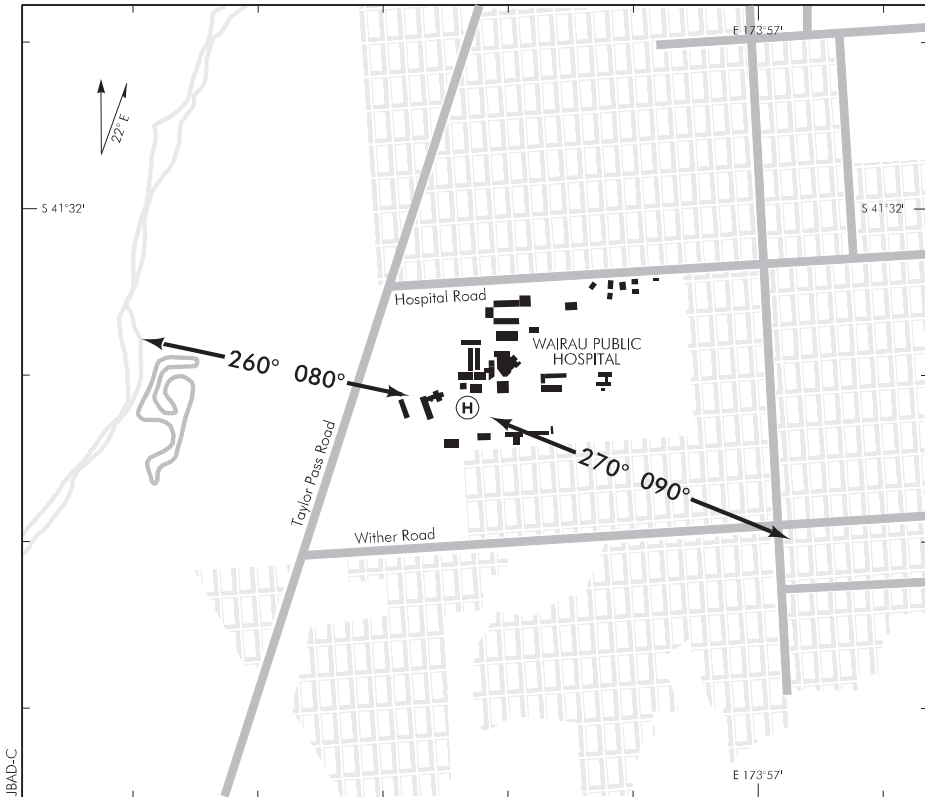

JBAD-C

Changes from 19 NOV 09: T658 amended to T654.

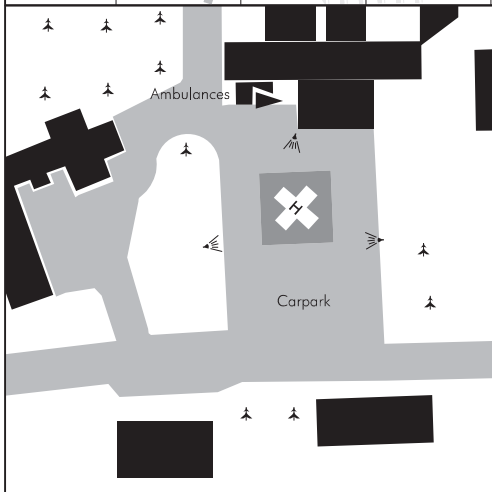

Heliport located within Woodbourne CTR/D — Transponder Mandatory.

Refer to VNC and Omasa/Woodbourne or Woodbourne/Omasa Vicinity chart for boundaries of Instrument Sector and VFR Transit Lane T654 Omasa.

S 41 32 12 E 173 56 37*

Effective: 18 NOV 10

© Civil Aviation Authority

WAIRAU HOSPITAL HELIPORT

FATO/TLOF

	SIZE	SFC	STRENGTH	MARKINGS
FATO	20m x 20m	B		
TLOF	6m x 6m	B		Standard

Maximum helicopter size 13m overall length.

LIGHTING

FATO: Floodlighting

FACILITIES

Nil

SUPPLEMENTARY

Operator: Nelson-Marlborough District Health Board,
Private Bag 18, Nelson
Tel (03) 546 1800 Fax (03) 546 1680

Available for limited use (normally only dedicated Air Ambulance) subject to the prior agreement of the operator.