

ELEV 51

NZJG

NON-CERTIFICATED


GISBORNE HOSPITAL

HELIPORT

GISBORNE TOWER: 127.3 118.2


GISBORNE ATIS: 126.4

UNATTENDED: 127.3

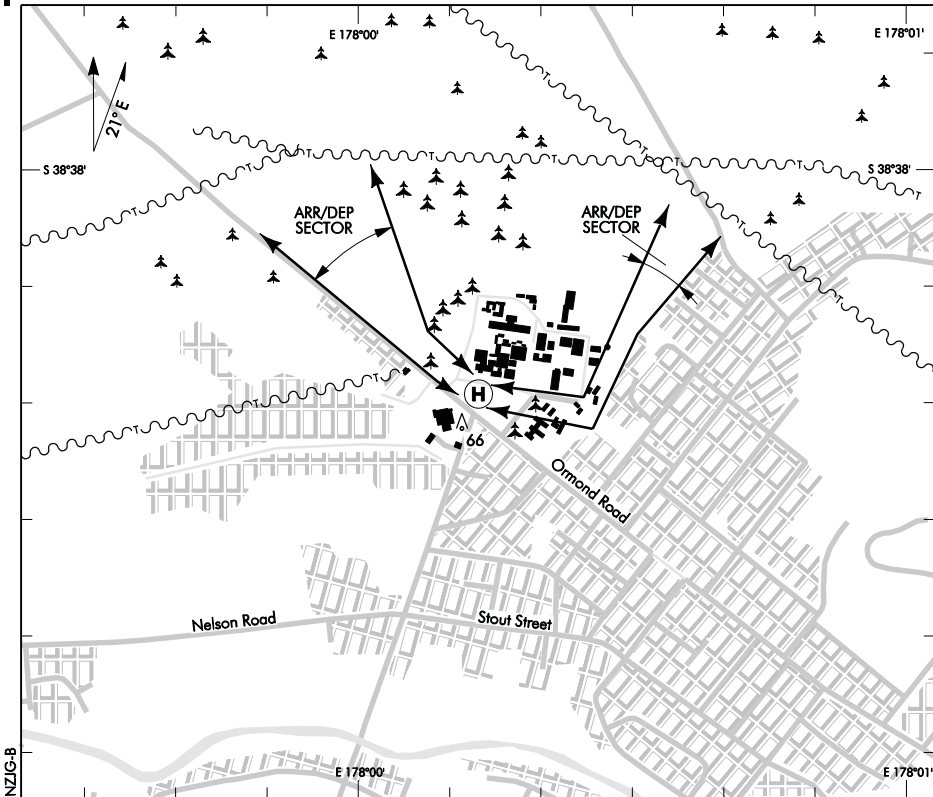

NZJG-B

Changes from 4 SEP 03: ARR/DEP tracks, OP instructions, noise abatement, ARR.

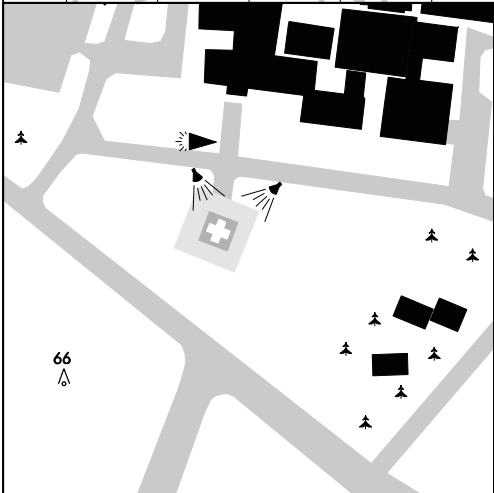

Heliport located within Gisborne CTR/D.

All flights to the helipad are to conform with CAR 91.127(d)(3). The preferred ARR/DEP routes for non-performance class 1 helicopters is depicted.

CAUTION: Unlit 66ft high cellphone tower approx 90m southwest of TLOF.

Noise abatement — all aircraft should use the arrival/departure tracks as portrayed. These tracks (which involve the use of a small dog-leg) take into account local noise abatement and safety considerations.

S 38 38 19 E 178 00 13*

Effective: 17 NOV 11

Non-Certificated Heliport 1.9NM NNW of
Gisborne city centre

NZJG

GISBORNE HOSPITAL

OPERATIONAL DATA

FATO/TLOF

	SIZE	SFC	STRENGTH	MARKINGS
FATO	28m x 28m	B		
TLOF	12m x 12m	Conc		Standard

LIGHTING

Perimeter: Standard amber and blue activated on notification of inbound flight

Floodlighting: Permanently activated during hours of darkness

FACILITIES

Security personnel are deployed at the helipad to manage public and vehicle access at all times prior to helicopter arrival until after departure

SUPPLEMENTARY

Operator: Tairāwhiti District Health Board, Private Bag 7001, Gisborne 4040
Tel (06) 869 0500 Fax (06) 869 0534

Gisborne Hospital helipad is available for limited use subject to prior approval of the Operator.

The Emergency Department and/or helipad safety personnel require reasonable prior notification of all landings.

All emergency landing notifications are to be made to Gisborne Hospital Emergency Department using the St John Ambulance radio telephone or by telephoning the hospital switchboard on Tel (06) 869 0500 to ensure that they are prepared to receive the patient/s and instigate emergency care.

All other landing notifications including medical retrievals are to be made to the hospital switchboard by telephone (06) 869 0500 to ensure that helipad safety personnel are available.

Hospital orderlies are available to assist with transportation of patients and medical equipment between the helicopter and the hospital.