

ELEV 49


NZJH

NON-CERTIFICATED

HASTINGS HOSPITAL


HELIPORT

UNATTENDED: 125.8

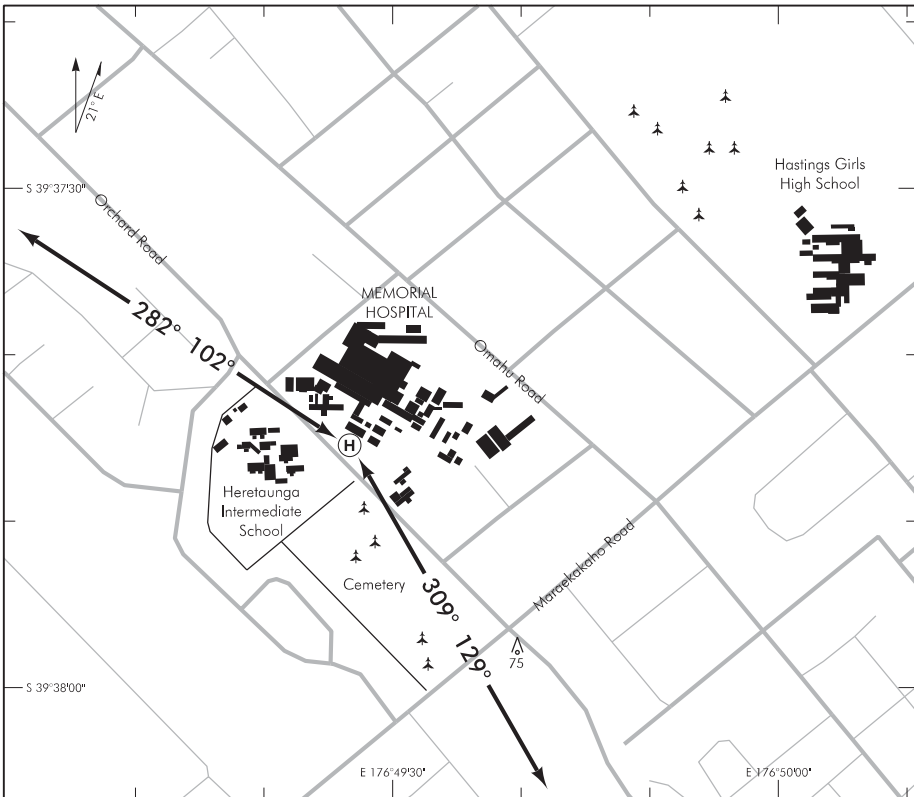

NZJH-C

Changes from 28 JUL 11: Caution note amended to add liquid oxygen tank.

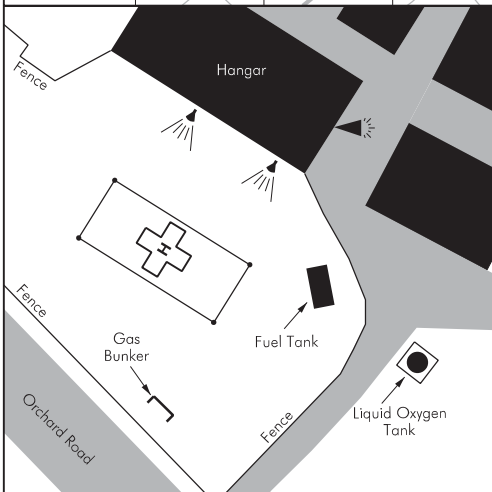

- Heliport located adjacent to Napier CTR/D
- Hangar sited immediately NE of heliport
- Make all take-offs and approaches as steep as possible due to nearby residential areas
- Approach and departure over adjacent school ground is not allowed during school hours
- **CAUTION:** Nearby gas bunker and fuel tank. Liquid oxygen tank 40 m E of helipad, approximately 40 ft AGL.
- Unless advised otherwise, park on eastern side of helipad
- All operations are to comply with Civil Aviation Rule 91.127(d)(3) or the provisions and limitations of Section 13A of the Civil Aviation Act 1990

S 39 37 48 E 176 49 26*

Effective: 8 NOV 18

© Civil Aviation Authority

HASTINGS HOSPITAL

HELIPORT

FATO/TLOF

	SIZE	SFC	STRENGTH	MARKINGS
FATO	28 m x 28 m	Gr		
TLOF	25 m x 12 m	Asph		Standard

Maximum helicopter size 15 m overall length.

LIGHTING

Four blue perimeter lights and floodlighting.

Lit WDI located on eastern side of hangar roof.

FACILITIES

Jet A1 fuel available via operator.

Telephone, toilets.

SUPPLEMENTARY

Operator: Hawkes Bay Helicopter Rescue Trust, PO Box 402, Hastings
 Tel (06) 878 1630 (Administration), (06) 878 1633 (Hangar),
 Fax (06) 878 1634, Mobile (027) 442 6524 or (027) 492 7277 (H24)

Hospital orderlies are available to assist with transportation of patients and medical equipment between the helicopter and hospital, either by making a radio call to the Emergency Department via ambulance radio (R40) or by contacting the Emergency Department Shift Coordinator on 06 878 8109 Ext 2661. Advise requirements and ETA at helipad to the Shift Coordinator at least 15 minutes prior.

Available only with prior permission of the operator.