

ELEV 1349

NZJZ



NON-CERTIFICATED

TAUPO HOSPITAL

HELIPORT

BAY APPROACH: 123.6

UNATTENDED: 118.4

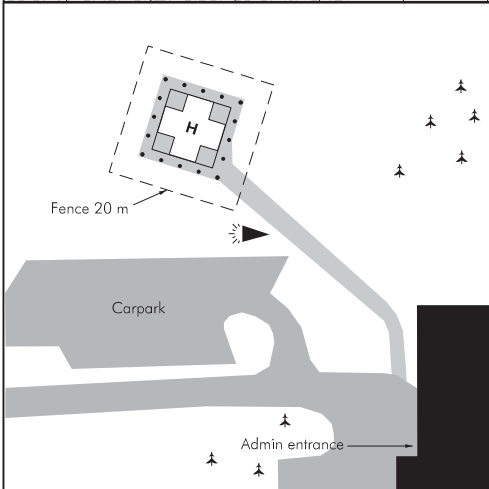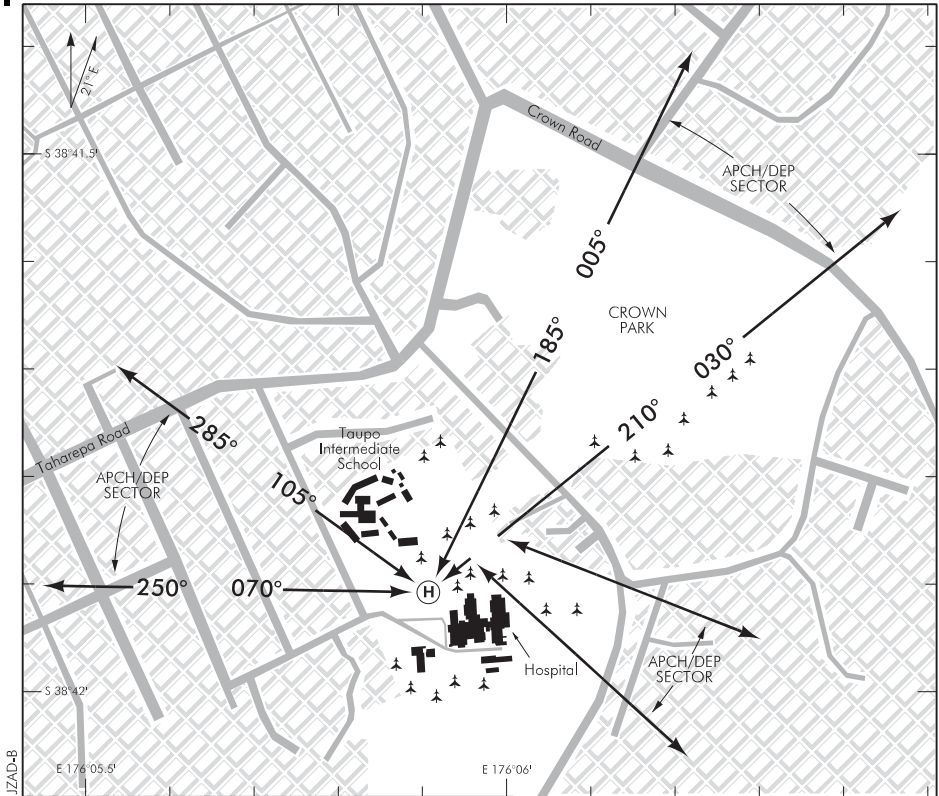

Heliport at NW corner of hospital.

Departing IFR helicopters — depart VFR and contact Bay Approach for clearance and traffic information prior to entering controlled airspace or IMC. Outside Control hours contact Bay Approach 123.6 MHz or Tel 0800 626 756 (landline users only) or (03) 358 1509 (cellphone users).

Arriving IFR helicopters — flight plans can be terminated on 123.6 MHz or Tel 0800 626 756 (landline users only) or (03) 358 1509 (cellphone users).

S 38 41 55 E 176 05 56

Effective: 29 MAR 18

© Civil Aviation Authority

TAUPO HOSPITAL HELIPORT

Non-Certificated Heliport 2.5 NM N of
Taupo airport
NZJZ

TAUPO HOSPITAL

OPERATIONAL DATA

FATO/TLOF

	SIZE	SFC	STRENGTH	MARKINGS
FATO	Diameter 26 m	Gr		
TLOF	6 m x 6 m	Conc		Standard H

Maximum helicopter size 13 m overall length.

LIGHTING

FATO: Nil but nearby carpark floodlit.

TLOF: Perimeter — blue/yellow.

WDI: Controlled via light sensor linked to carpark lighting.

Helipad lighting is controlled by the Taupo Hospital Emergency Dept. Tel (07) 376 1000.

Note that this number is transferred to Rotorua 24hr telephonist after hours (from 1700 hrs each night) but caller can be transferred back to Taupo by the Rotorua telephonist.

FACILITIES

Nil

SUPPLEMENTARY

Operator: Lakes District Health Board, Taupo Hospital, PO Box 841, Taupo.
Tel (07) 349 7946 Fax (07) 349 7942

For private use on a limited basis — requires prior approval of the operator.