

ELEV 367


NZMH

NON-CERTIFICATED

WAIRARAPA HOSPITAL

HELIPORT

UNATTENDED: 119.1

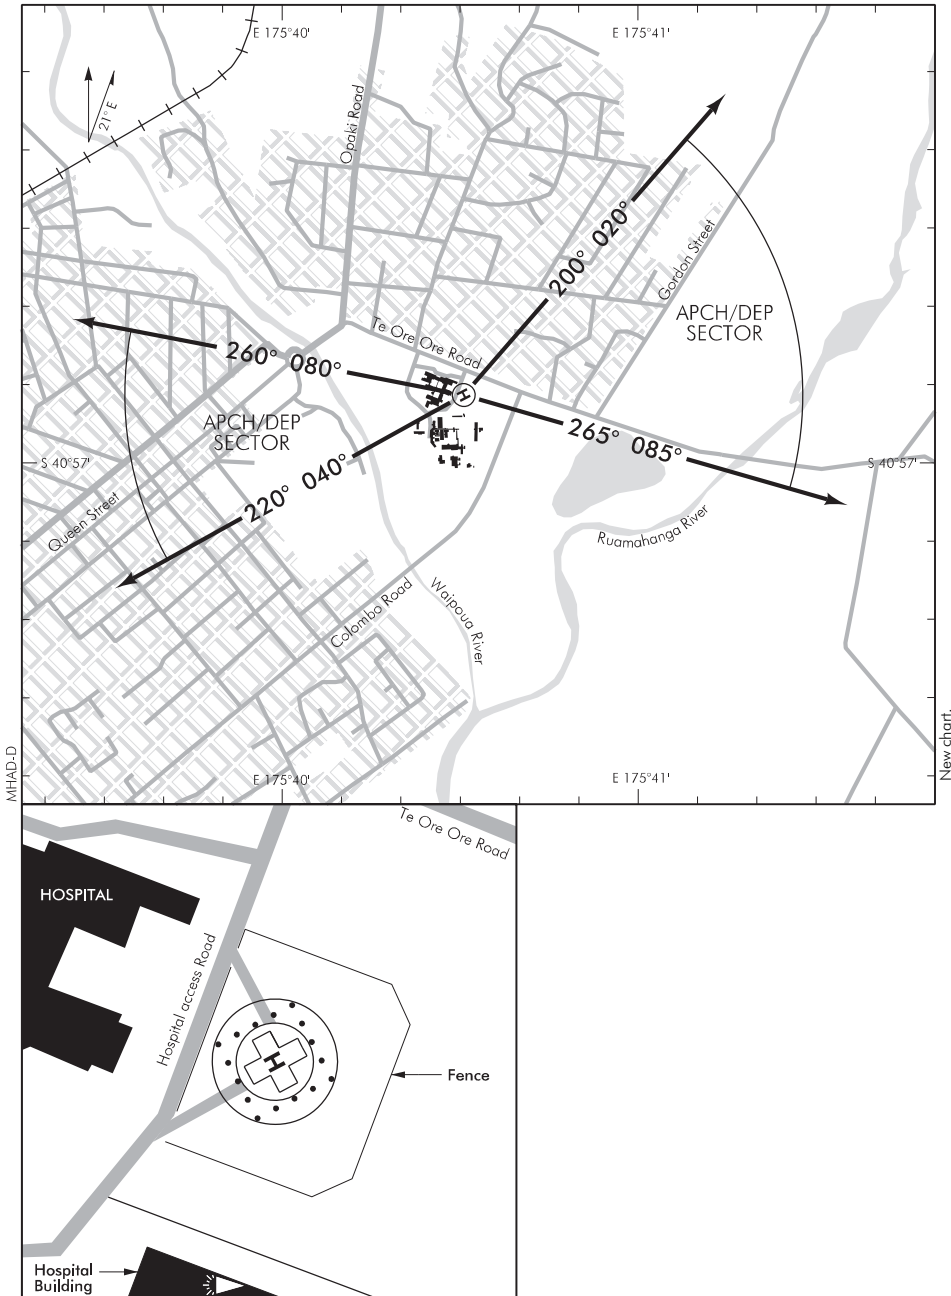

MHAD-D

New chart.

S 40 56 51 E 175 40 31

Effective: 14 FEB 08

© Civil Aviation Authority

WAIRARAPA HOSPITAL

HELIPORT

NZMH

OPERATIONAL DATA**FATO/TLOF**

	SIZE	SFC	STRENGTH	MARKINGS
FATO	50 m x 50 m	Gr		
TLOF	14 m diameter	Conc	30 MPa	Standard

Maximum helicopter size 17.4 m overall length.

LIGHTING

TLOF: Perimeter green (infrared facility for night vision)

FACILITIES

Nil

SUPPLEMENTARY

Operator: Wairarapa District Health Board, PO Box 96, Blair Street, Masterton.
Tel (06) 946 9800 Fax (06) 946 9817

Available for limited use subject to the prior agreement of the operator through Ambulance Service Operations Officer/Duty Officer.