

ELEV 250


NZTQ

NON-CERTIFICATED


# TE KUITI HOSPITAL

## HELIPORT

UNATTENDED: 119.1

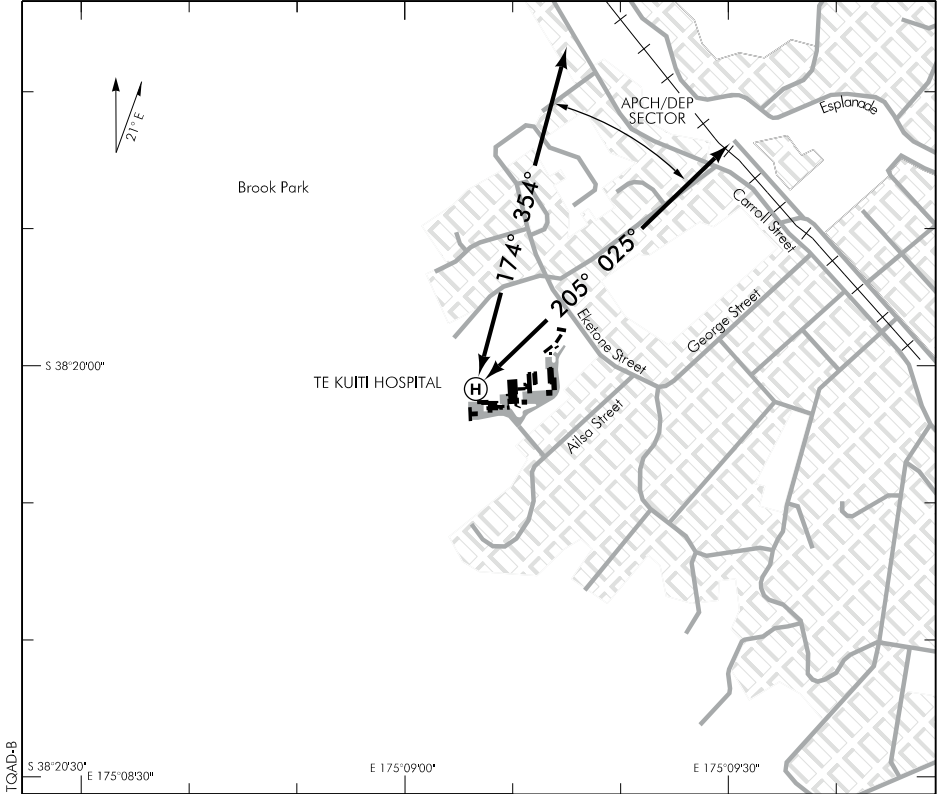

Changes from 28 SEP 06: Helipad relocated, hospital layout updated, ARP.

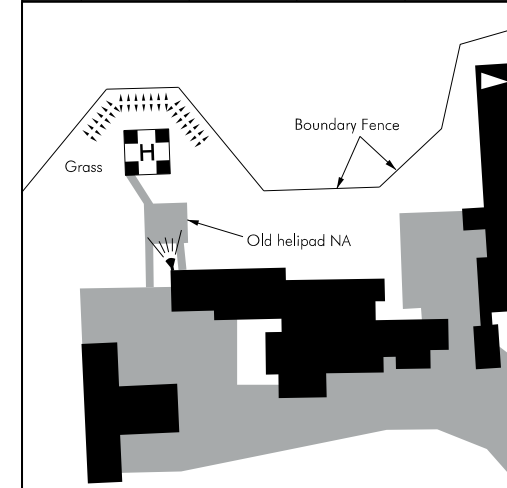

Contact Te Kuiti Hospital Emergency Dept before landing.

**CAUTION:** Old helipad 12 m to SE of TLOF not to be used.

S 38 20 02 E 175 09 07\*

**Effective: 17 SEP 15**

© Civil Aviation Authority

# TE KUITI HOSPITAL HELIPORT

**FATO/TLOF**

	SIZE	SFC	STRENGTH	MARKINGS
FATO	Diameter 22 m	Gr		
TLOF	8 m x 8 m	CONC	5000	Standard H

Maximum helicopter size 17 m overall length.

**LIGHTING**

Floodlighting — Contact Te Kuiti Hospital Emergency Dept for operation  
Tel (07) 878 7333

**FACILITIES**

Nil

**SUPPLEMENTARY**

Operator: Waikato District Health Board, Te Kuiti Hospital  
Ailsa Street, Te Kuiti  
Tel (07) 878 7333 Fax (07) 878 8231

Available for limited use subject to the prior approval of the operator.